

Excellent Integrated System Limited

Stocking Distributor

Click to view price, real time Inventory, Delivery & Lifecycle Information:

[Fairchild Semiconductor](#)
[HLMAQH00A](#)

For any questions, you can email us directly:


sales@integrated-circuit.com



SOLID STATE LED LAMPS

SUBMINIATURE T-1 3/4 (1.9mm)

PACKAGE DIMENSIONS

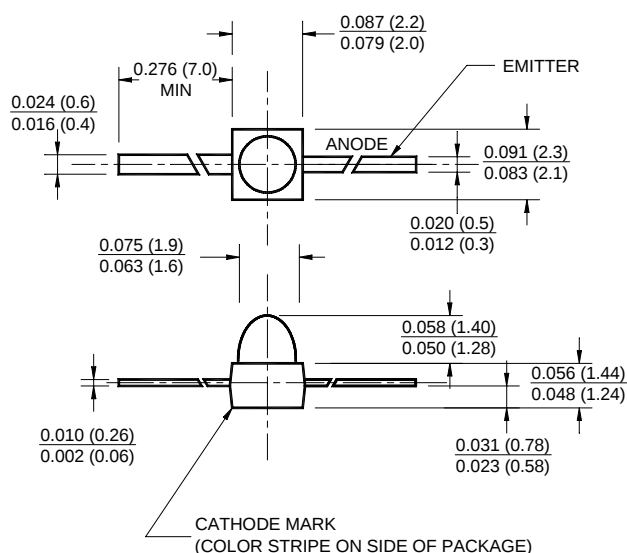


NOTE:
Dimensions are in inches (mm).

AlGaAs RED	HLMP-Q106A	Clear
AlInGaP ORANGE	HLMA-QH00A	Clear
AlInGaP YELLOW	HLMA-QL00A	Clear

FEATURES

- Subminiature package
- Low profile package
- Three lead bend options for surface mounting
- Available in tape and reel

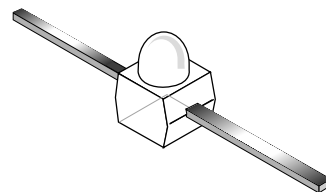

DESCRIPTION

These subminiature LED lamps are intended for high volume, low cost status indication on PCBs, as well as for backlighting keyboards and switches. Choices of "Yoke", "Z-Bend" or "Gull-Wing" lead bends are available.

ABSOLUTE MAXIMUM RATINGS ($T_A = 25^\circ\text{C}$ unless otherwise specified)

Parameter	AlGaAs Red HLMP-Q106A	AlInGaP Orange HLMA-QH00A	AlInGaP Yellow HLMA-QL00A	Units
Continuous Forward Current - I_F	50	50	50	mA
Peak Forward Current - I_F ($f = 1.0 \text{ KHz}$, Duty Factor = 1/10)	200	100	100	mA
Reverse Voltage - V_R ($I_R = 10 \mu\text{A}$)	5	5	5	V
Power Dissipation - P_D	100	120	120	mW
Operating Temperature - T_{OPR}	-40 to +100			$^\circ\text{C}$
Storage Temperature - T_{STG}	-40 to +100			$^\circ\text{C}$
Lead Soldering Time - T_{SOL}				$^\circ\text{C}$
Wave	260 for 5 sec			
Reflow	260 for 10 sec			

ELECTRICAL / OPTICAL CHARACTERISTICS ($T_A = 25^\circ\text{C}$)

Part Number	AlGaAs Red HLMP-Q106A	AlInGaP Orange HLMA-QH00A	AlInGaP Yellow HLMA-QL00A	Condition
Luminous Intensity (mcd)				$I_F = 20\text{mA}$
Minimum	50	150	150	
Typical	500	500	500	
Forward Voltage (V)				$I_F = 20\text{mA}$
Maximum	2.4	2.4	2.4	
Typical	1.9	1.9	1.9	
Peak Wavelength (nm)	660	620	590	$I_F = 20\text{mA}$
Spectral Line Half Width (nm)	20	18	15	$I_F = 20\text{mA}$
Viewing Angle ($^\circ$)	25	25	25	$I_F = 20\text{mA}$



SOLID STATE LED LAMPS

SUBMINIATURE T-1 3/4 (1.9mm)

AlGaAs RED	HLMP-Q106A	Clear
AlInGaP ORANGE	HLMA-QH00A	Clear
AlInGaP YELLOW	HLMA-QL00A	Clear

TYPICAL PERFORMANCE CURVES

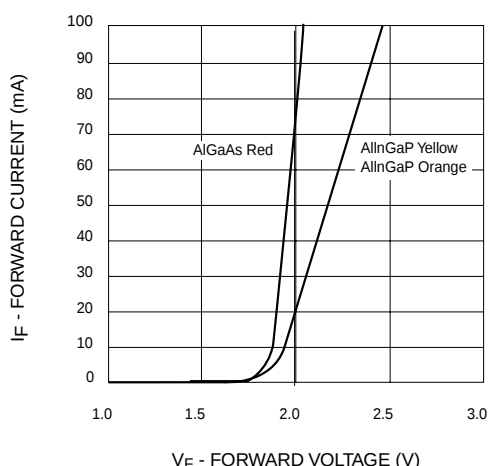


Fig. 1 Forward Current vs. Forward Voltage

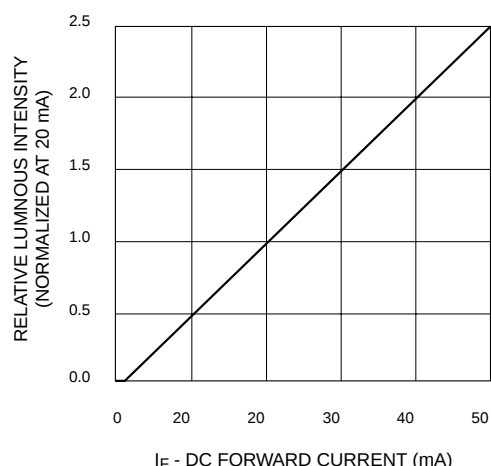


Fig. 2 Relative Luminous Intensity vs. DC Forward Current

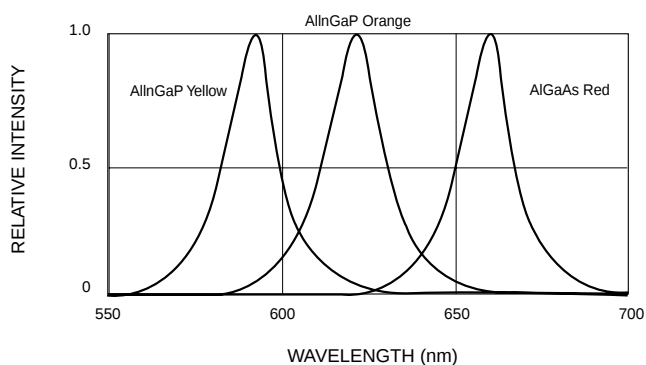


Fig. 3 Relative Intensity vs. Peak Wavelength

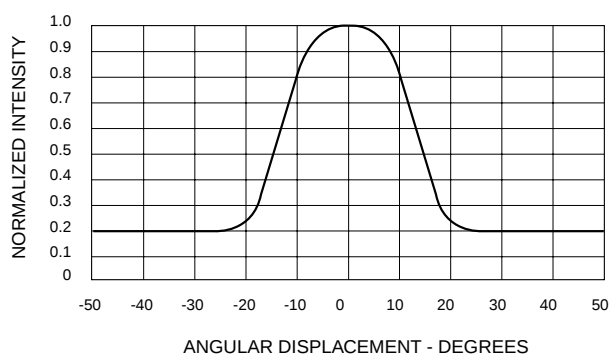



Fig. 4 Relative Luminous Intensity vs. Angular Displacement




SOLID STATE LED LAMPS SUBMINIATURE T-1 3/4 (1.9mm)

AlGaAs RED	HLMP-Q106A	Clear
AlInGaP ORANGE	HLMA-QH00A	Clear
AlInGaP YELLOW	HLMA-QL00A	Clear


Gull-Wing Lead Option

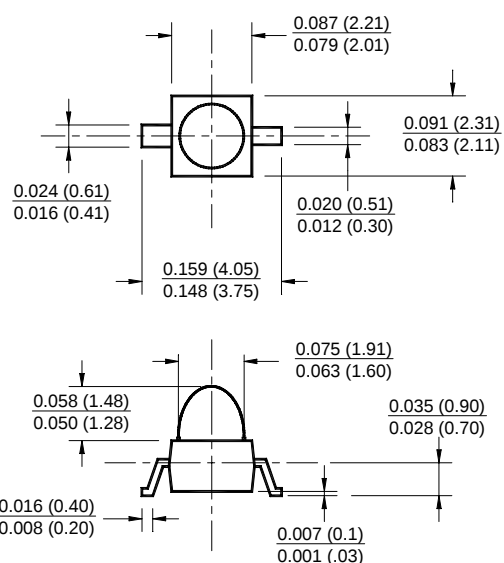

Yoke Lead Option

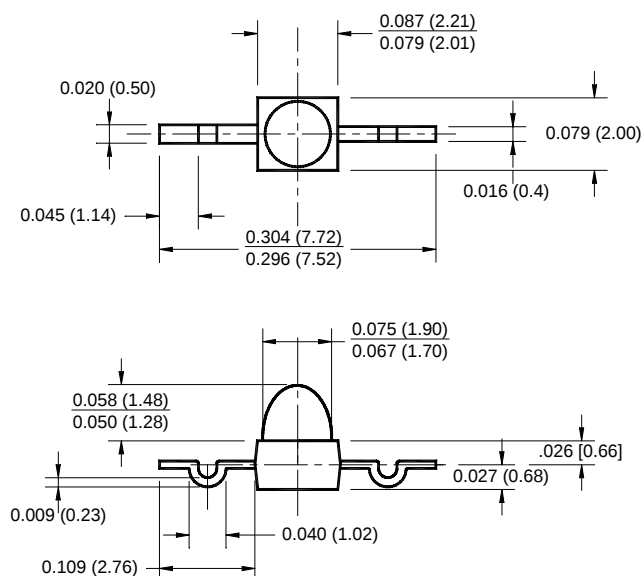

Z-Bend Lead Option

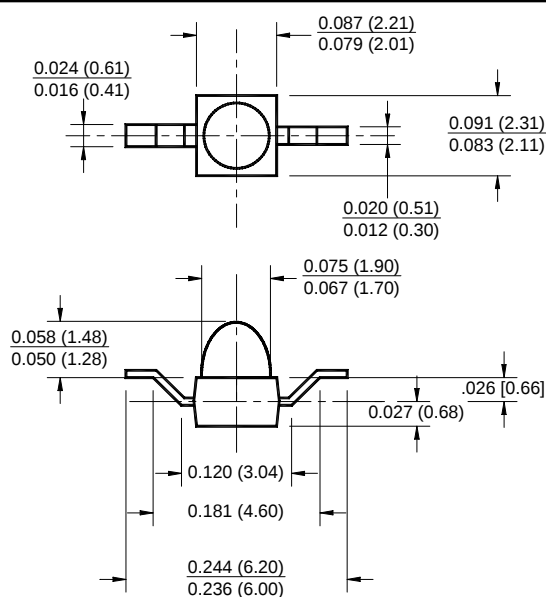

NOTE

All dimensions are in inches (millimeters)

www.qtopto.com

Call QT Optoelectronics for more information or the phone number of your nearest distributor.

United States 800-533-6786 • France 33 [0] 1.45.18.78.78 • Germany 49 [0] 89/96.30.51 • United Kingdom 44 [0] 1296 394499 • Asia/Pacific 603-7352417



SOLID STATE LED LAMPS

SUBMINIATURE T-1 3/4 (1.9mm)

DISCLAIMER

FAIRCHILD SEMICONDUCTOR RESERVES THE RIGHT TO MAKE CHANGES WITHOUT FURTHER NOTICE TO ANY PRODUCTS HEREIN TO IMPROVE RELIABILITY, FUNCTION OR DESIGN. FAIRCHILD DOES NOT ASSUME ANY LIABILITY ARISING OUT OF THE APPLICATION OR USE OF ANY PRODUCT OR CIRCUIT DESCRIBED HEREIN; NEITHER DOES IT CONVEY ANY LICENSE UNDER ITS PATENT RIGHTS, NOR THE RIGHTS OF OTHERS.

LIFE SUPPORT POLICY

FAIRCHILD'S PRODUCTS ARE NOT AUTHORIZED FOR USE AS CRITICAL COMPONENTS IN LIFE SUPPORT DEVICES OR SYSTEMS WITHOUT THE EXPRESS WRITTEN APPROVAL OF THE PRESIDENT OF FAIRCHILD SEMICONDUCTOR CORPORATION. As used herein:

1. Life support devices or systems are devices or systems which, (a) are intended for surgical implant into the body, or (b) support or sustain life, and (c) whose failure to perform when properly used in accordance with instructions for use provided in the labeling, can be reasonably expected to result in a significant injury of the user.
2. A critical component in any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.